




# Climate Data for Building Optimisation and Energy Management

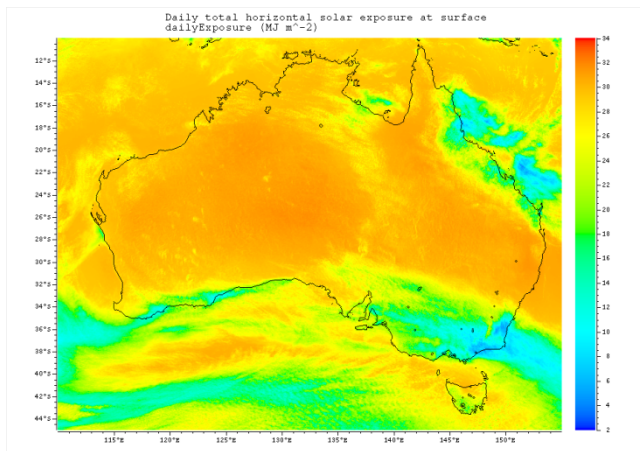

**Trevor Lee**

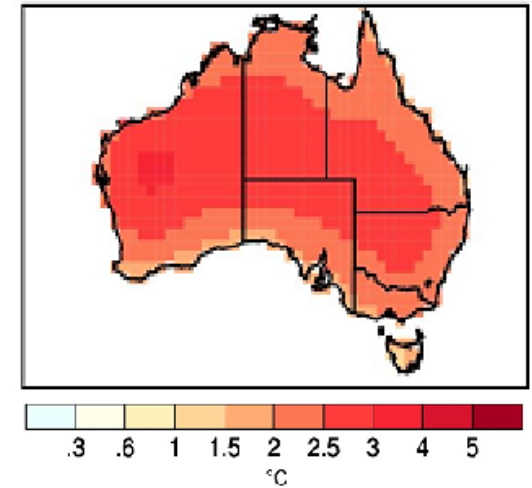

Solar Irradiation of Key Surfaces in Oodnadatta

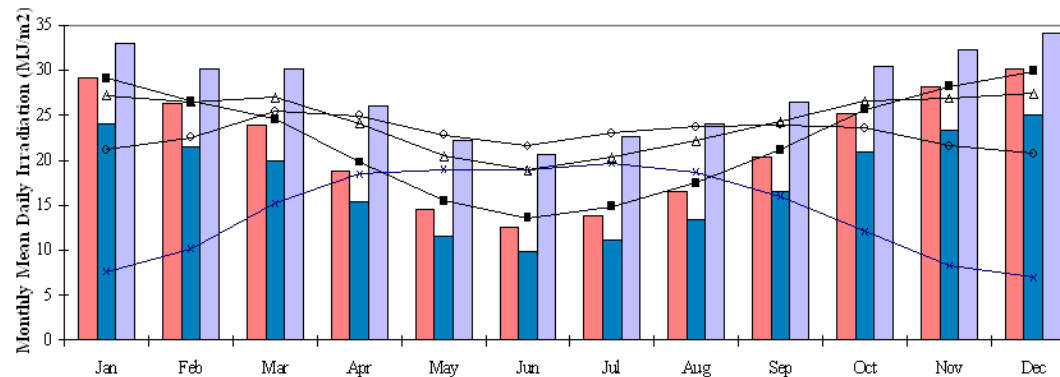

# Climate Data for Building Optimisation and Energy Management

## The Australian Solar and Climate Resource

- Australian Solar Radiation Data Handbook background and applications

## Beyond TMY: Climate Data for Specific Applications


- Australian Climate Data Bank and using Reference Meteorological Years

## Creation of Ersatz Future Weather Data Files

- Measuring energy performance of buildings under predicted future weather conditions

# The Australian Solar and Climate Resource

© AuSES

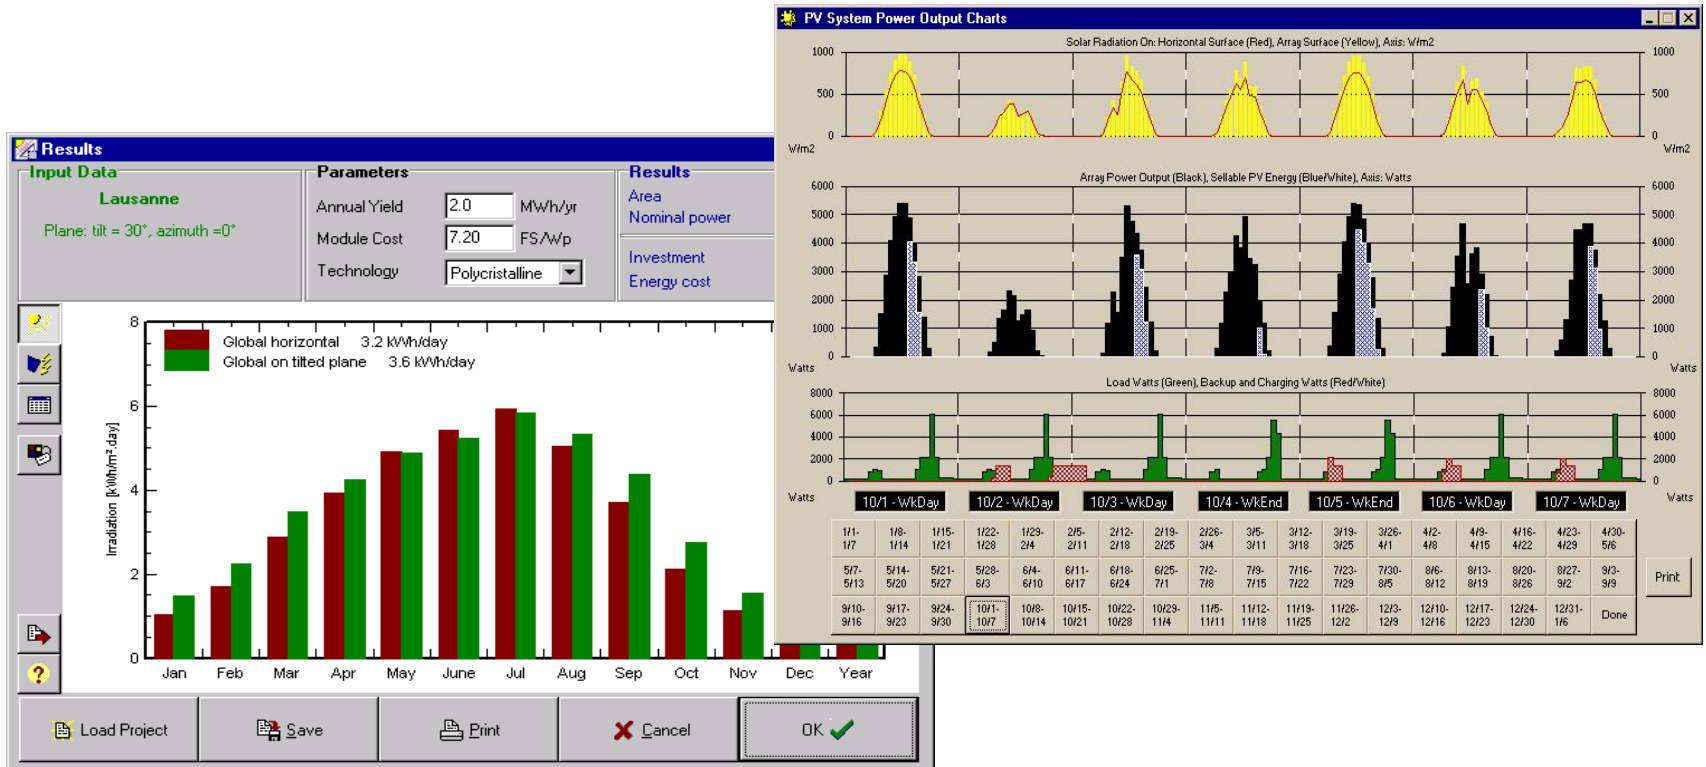

In association with Brett Stokes (Adelaide Applied Algebra)

# ASRDH – Data Presentation

## Australian Solar Radiation Data Handbook - AuSES

- **Table 1**      **Climate averages** (highest monthly mean, overall daily mean and lowest monthly mean) based on old ASRDH
- **Table 2**      **Clearness Index figures** (average hourly clearness figures for each month)
- **Tables 3**      **Solar radiation based on Horizontal Plane** (includes direct, diffuse, global and daily direct threshold percentages)
- **Tables 4**      **Vertical and Tracking Planes** – (Average total hourly irradiance (W/sq.m.) and daily irradiation (MJ/sq.m.) on a north-south axis tracking plane by hour for each month)
- **Tables 5**      **Daily totals by month for inclined planes** (Plane azimuth versus plane inclination)
- **Tables 6**      **Vertical windows** – (eg. Average hourly (W/sq.m.) and daily (MJ/sq.m.) solar heat gain factor through a north facing vertical window for each month)
- **Tables 7**      **Sequences of days** (e.g. Proportional occurrence (%) of sequences of days for which the daily global irradiation is less than 10 MJ/sq.m.)

# ASRDH - Sample Table


**Table 4.5:**

Average total hourly irradiance (W/sq.m.) and daily irradiation (MJ/sq.m.)  
on a north facing plane inclined at latitude angle for each month

Hour	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Year
5	1										1	3	
6	28	7							1	14	38	44	11
7	108	74	43	14	2			5	40	110	144	142	57
8	257	232	195	137	72	28	35	89	188	265	288	294	173
9	420	411	371	306	222	167	187	256	355	423	442	459	335
10	595	589	535	469	372	306	338	413	488	558	578	602	487
11	738	732	661	561	474	419	468	511	583	675	706	726	605
12	840	838	744	621	509	471	517	553	649	725	779	794	670
13	869	870	777	617	505	463	504	553	640	718	779	808	675
14	816	818	726	557	438	409	462	494	583	666	705	747	619
15	697	699	614	444	325	309	351	401	475	538	574	620	504
16	537	542	448	303	189	182	224	270	336	384	424	465	359
17	354	349	269	135	57	44	73	119	179	218	246	300	195
18	171	158	88	19	2		3	13	35	59	91	133	64
19	48	31	7							5	20	42	13
20	4	2										4	1
Daily	23.3	22.9	19.7	15.1	11.4	10.1	11.4	13.2	16.4	19.3	20.9	22.3	17.2

# ASRDH - Sample Graph


Solar Irradiation of Key Surfaces in  
Oodnadatta

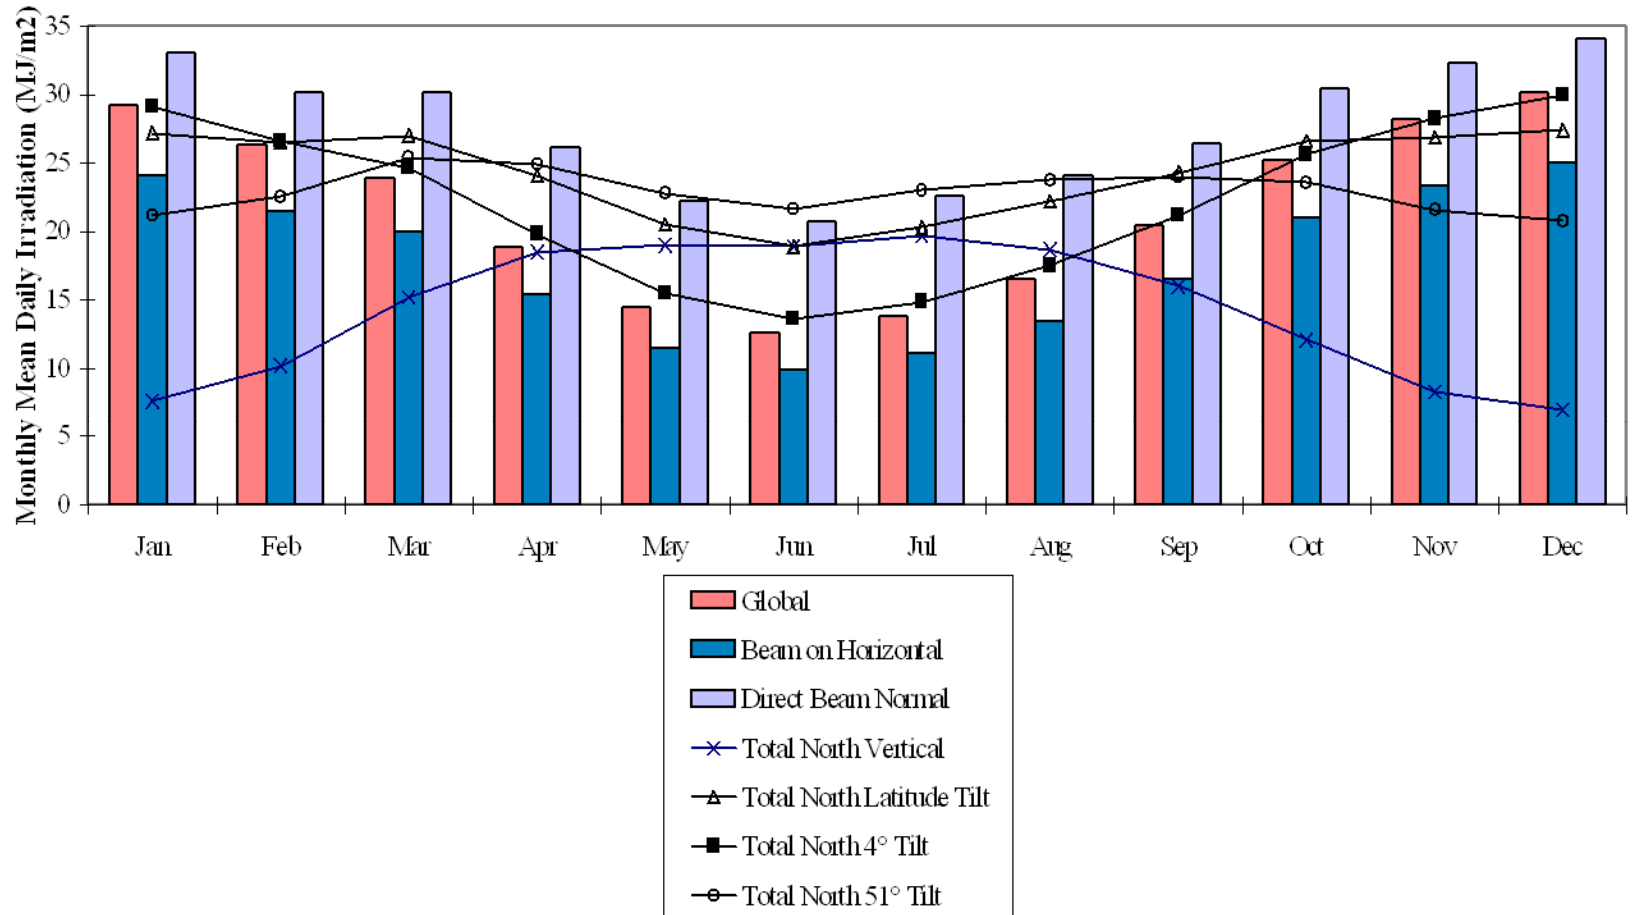

# Climate Data Source

- **An enhanced ACDB could be used as the data source for ASRDH 5.**
  - **100 sites most with ersatz solar irradiation data inferred from satellite measurements of radiation being reflected back into space.**
  - **With simultaneous temperature, humidity, wind speed and direction and cloud cover (octas).**
  - **Impractical as a reference book so likely to be an enhanced version of AUSOLRAD.**
  - **Non-reference meteorological “years”**


# Climate Data - satellite measurement

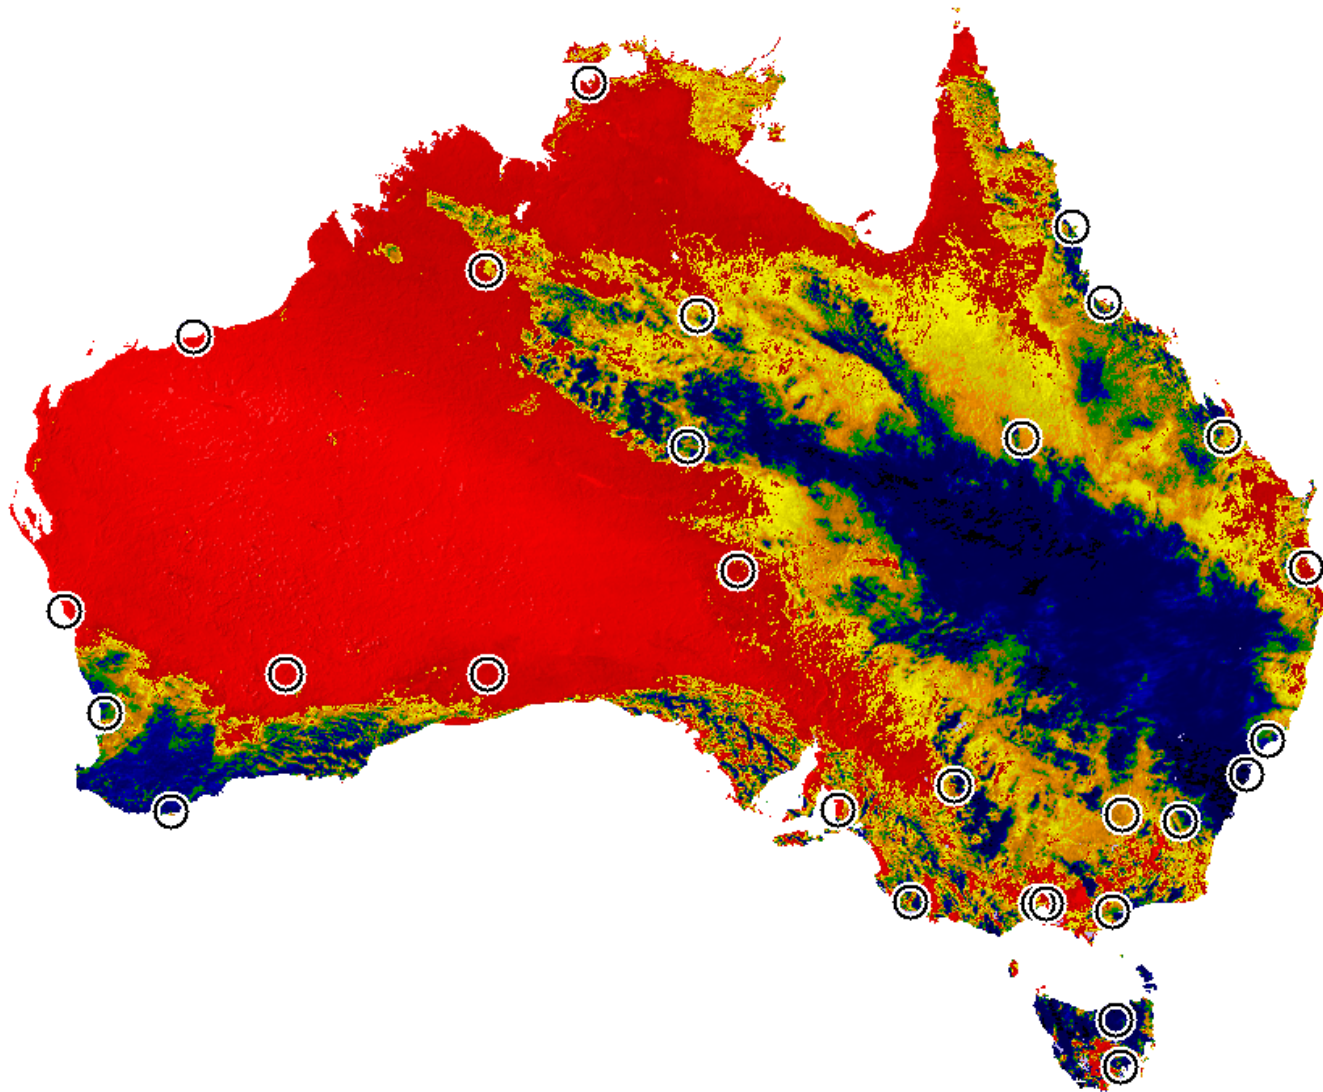



# Climate Data - satellite measurement

## Exemplary Australian Solar Energy Atlas

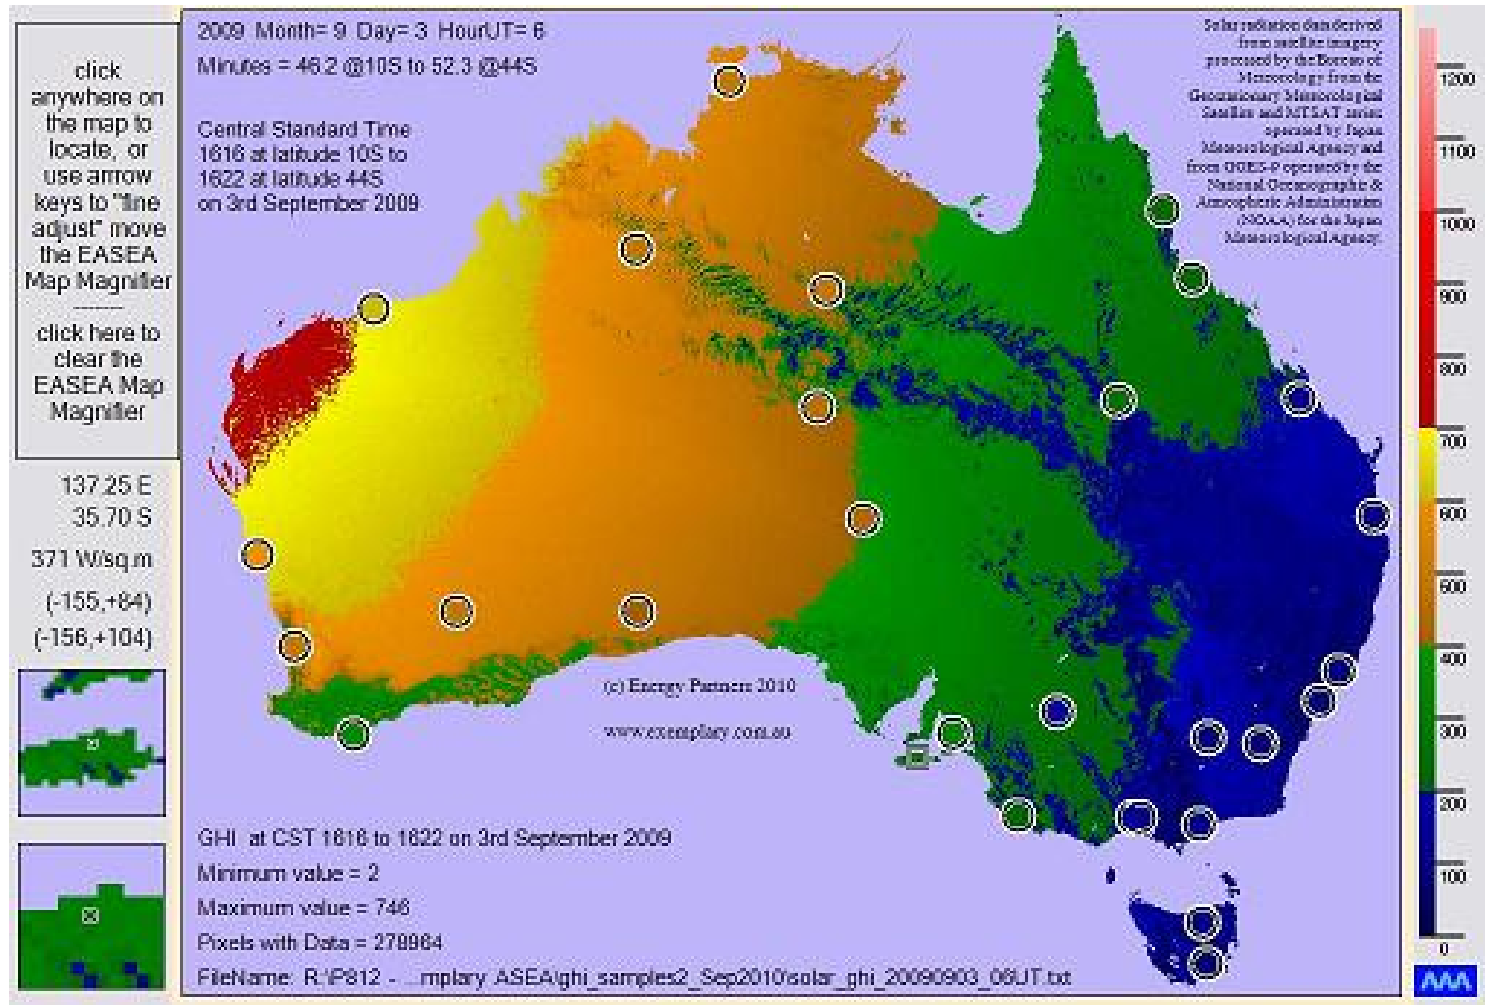

# Solar Data Source - AUSOLRAD

- **User selects:**


- orientation in 1° increments
- tilt in 1° increments (including facing down)
- Depth of overhang
- Reflectivity of the “ground”

- **AUSOLRAD produces:**

- Tables for all geometries of engineering and architectural interest including single and double axis tracking
- NO frequency tables for storage design optimisation

- **Distributed by AuSES**

# Beyond TMY: Climate Data for Specific Applications

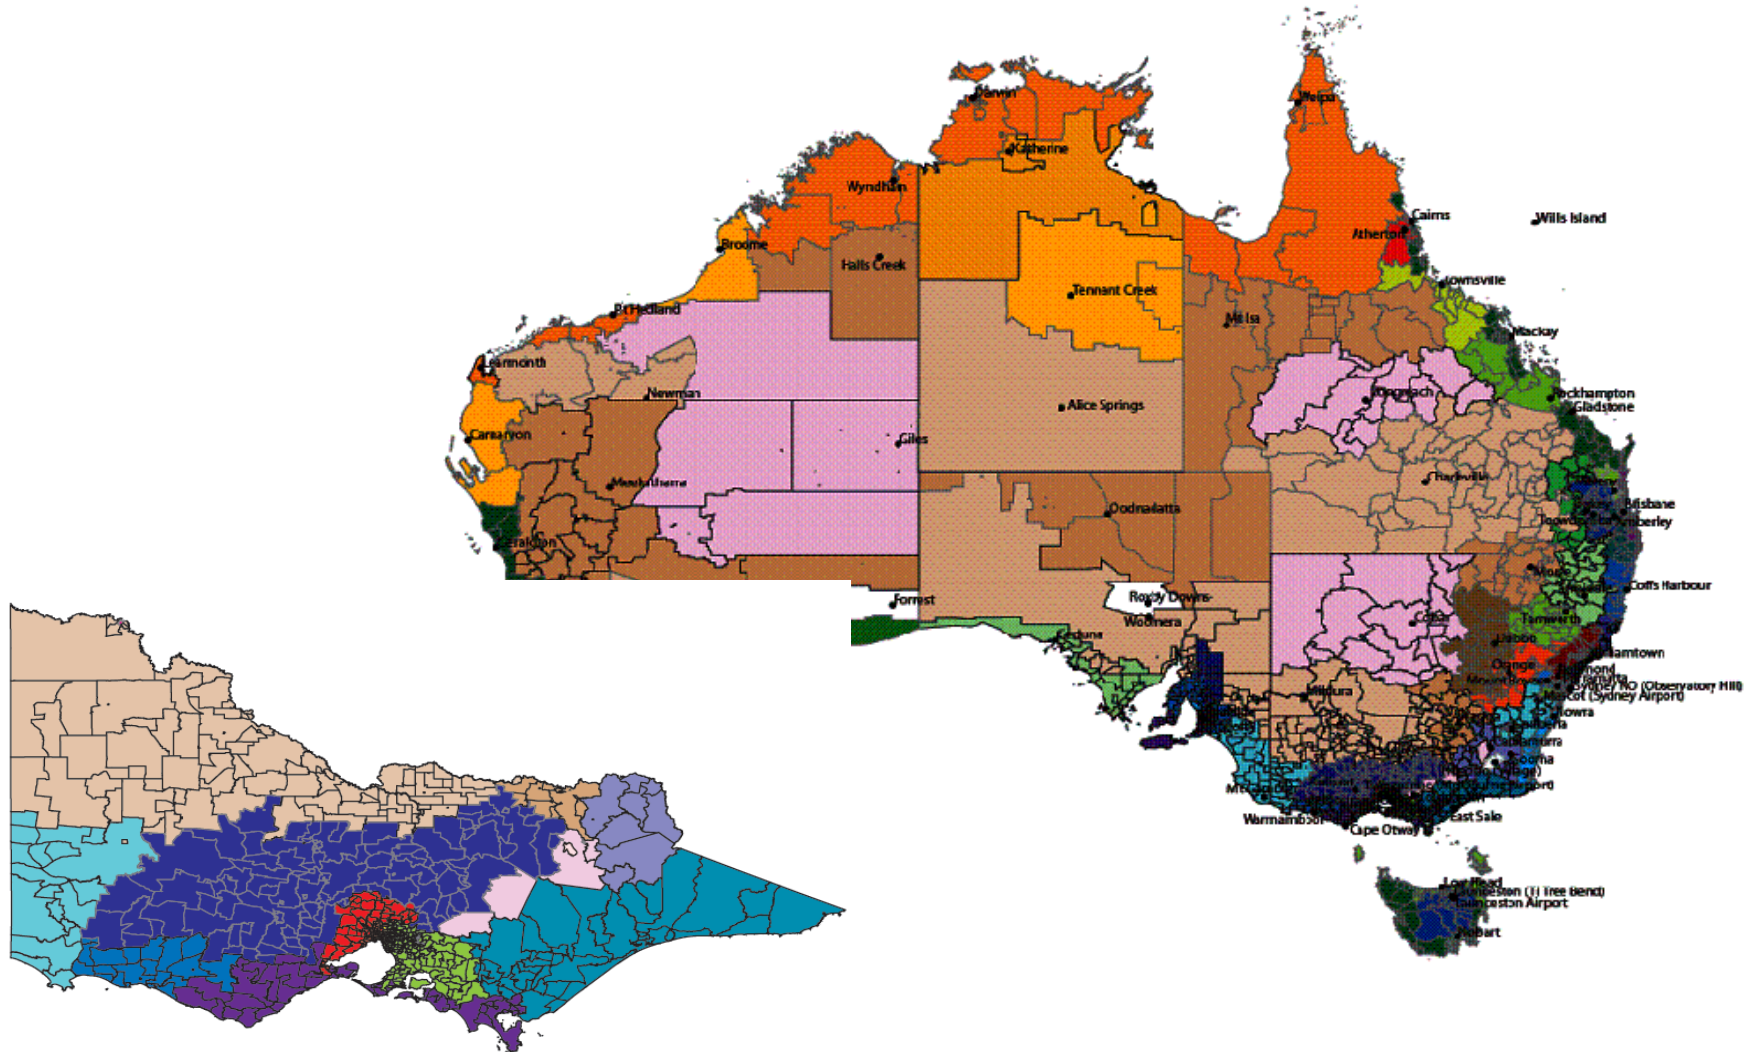

# Background

## Weightings for RMY datasets

### *Weights for RMY with recorded diffuse irradiance*

<b>Weather Element</b>	<b>Weighting</b>
Max Temp	1/20
Min Temp	1/20
Mean Temp	2/20
Max Wet Bulb Temp	1/20
Min Wet Bulb Temp	1/20
Mean Wet Bulb Temp	2/20
Max Wind Velocity	1/20
Mean Wind Velocity	1/20
Global Radiation	5/20
Diffuse Radiation	5/20

### *Weights for RMY without recorded diffuse irradiance*

<b>Weather Element</b>	<b>Weighting</b>
Max Temp	1/15
Min Temp	1/15
Mean Temp	2/15
Max Wet Bulb Temp	1/15
Min Wet Bulb Temp	1/15
Mean Wet Bulb Temp	2/15
Max Wind Velocity	1/15
Mean Wind Velocity	1/15
Global Radiation	5/15
Diffuse Radiation	0/15

# Further Enhancements

## Using alternative RMY-month selection procedures

Weighted Mean calculations can be further modified to create:

- **Bias towards data from recent years to represent future climate expectations**
- **Weighting extreme conditions (eXtreme Meteorological Year: XMY)**

# Modifying Weather Element Weights

meteorological data to meet any set of weightings

Examples include:

Potential weights for large office buildings		Potential weights for wind farms		Potential weights for solar-sensitive infrastructure	
Weather Element	Weighting	Weather Element	Weighting	Weather Element	Weighting
Max Temp	1/12	Max Temp	1/15	Max Temp	1/20
Min Temp	1/12	Min Temp	1/15	Min Temp	0/20
Mean Temp	2/12	Mean Temp	1/15	Mean Temp	1/20
Max Wet Bulb Temp	1/12	Max Wet Bulb Temp	0/15	Max Wet Bulb Temp	0/20
Min Wet Bulb Temp	1/12	Min Wet Bulb Temp	0/15	Min Wet Bulb Temp	0/20
Mean Wet Bulb Temp	2/12	Mean Wet Bulb Temp	0/15	Mean Wet Bulb Temp	0/20
Max Wind Velocity	1/12	Max Wind Velocity	5/15	Max Wind Velocity	2/20
Mean Wind Velocity	1/12	Mean Wind Velocity	5/15	Mean Wind Velocity	1/20
Global Radiation	2/12	Global Radiation	1/15	Global Radiation	10/20
Diffuse Radiation	0/12	Diffuse Radiation	1/15	Diffuse Radiation	5/20

# Representative Extremes

**eXtreme Meteorological Year (XMY) data sets still require full definition**

**Examples include**

- **Performance during a hot, dry (El Niño) year**
- **Performance during a windy, wet (La Niña) year**
- **Amalgamation of 'hottest summer' with 'coldest winter' months**
- **Warmest months ever (changed warmer climate)**

# Real-time Data

- **Many commercial buildings now being simulated for BCA compliance certification (Verification Method 3 under Section J, called JV3 for short)**
- **Exemplary buildings always simulated for design refinement and for NABERS Energy “commitment agreement”**
- **Allows marketing “green” credentials before the accumulation of 12 months of running experience (and bills)**



# Real-time Data

- **Model Calibration (as built and operated)**
- **Building or system monitoring**  
Real-time year-to-date data (RTY)  
Real-time billing period data (RTBP)
- **Fosters early detection and remedial action to save energy expenditure and secure the NABERS Energy rating**
- **Measuring actual consumption (or output) in the previous year relative to RMY**


# Results

## Comparison of:

- ACDB 2005 RMY
- ACDB RMY-A
- ACDB RMY-B
- ACDB RMY-C
- RTY
- DTD (decade-to-date)
- 40 year historical averages


*Using 11 house models with varying energy usage in the CSIRO thermal simulation software, AccuRate*

# Key Results

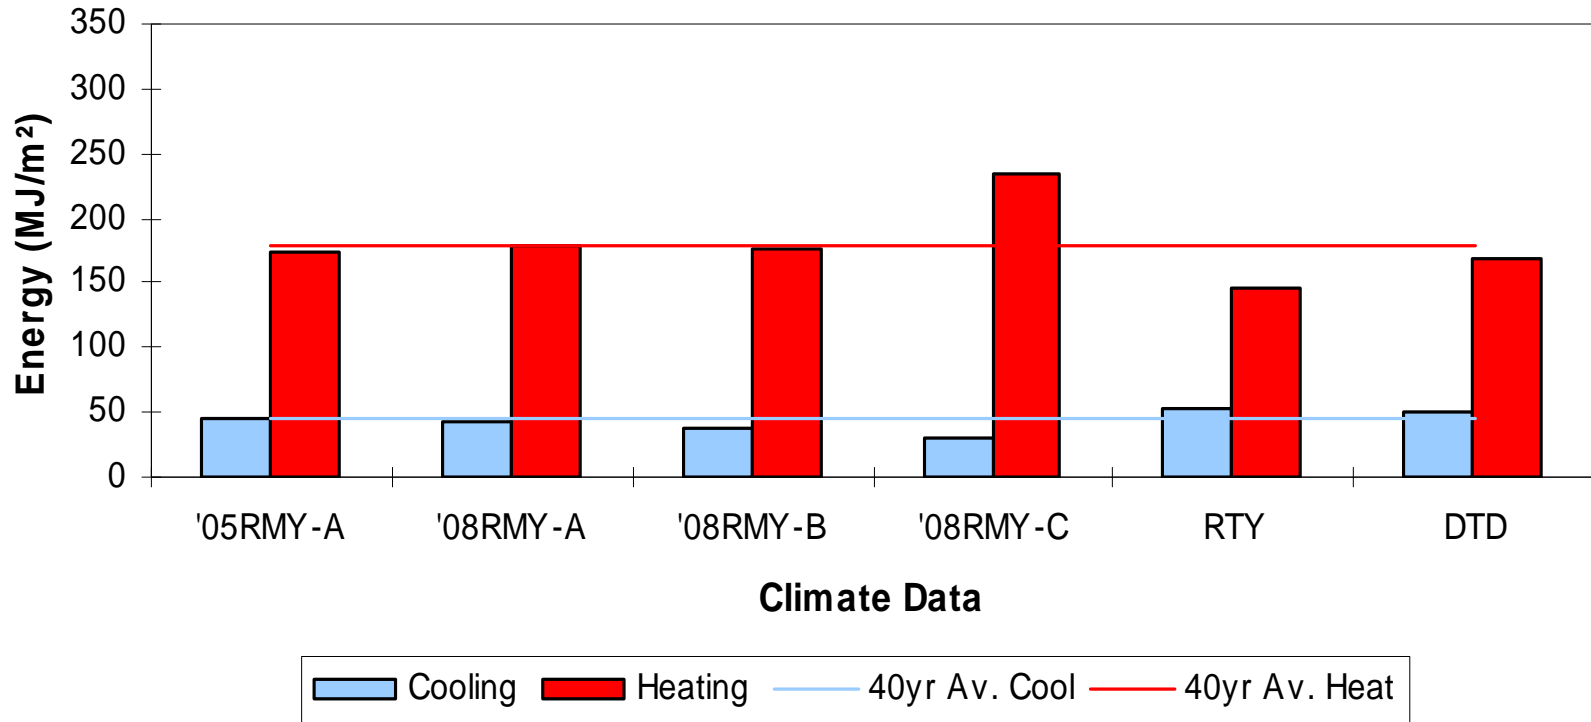


**Figure 1: Simulated consumption of a 'lightweight' dwelling at 0° orientation**

# Key Results

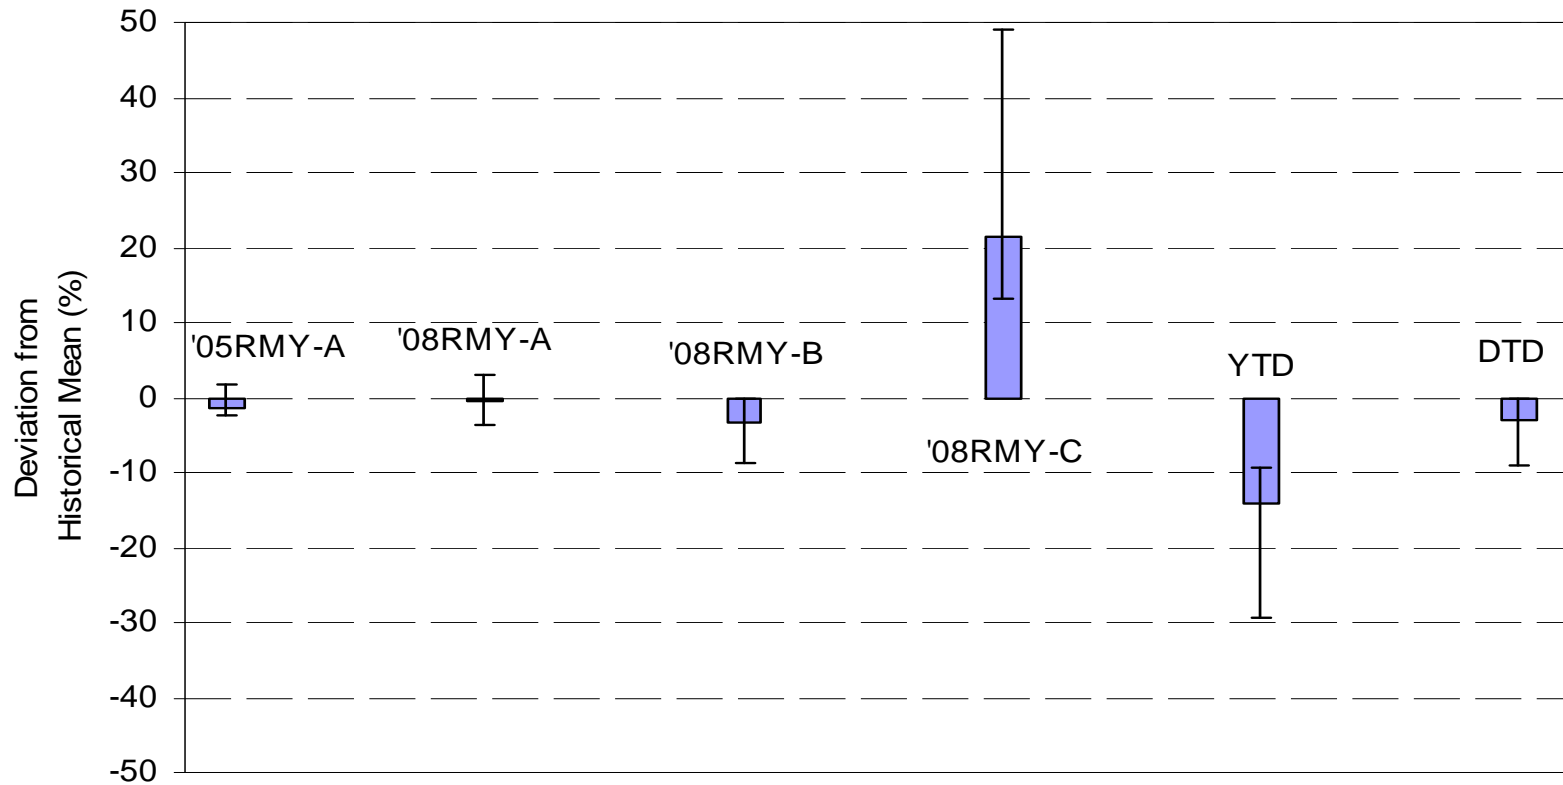


**Figure 2: Average difference between simulation results using representative data and historical mean**

# Key Results

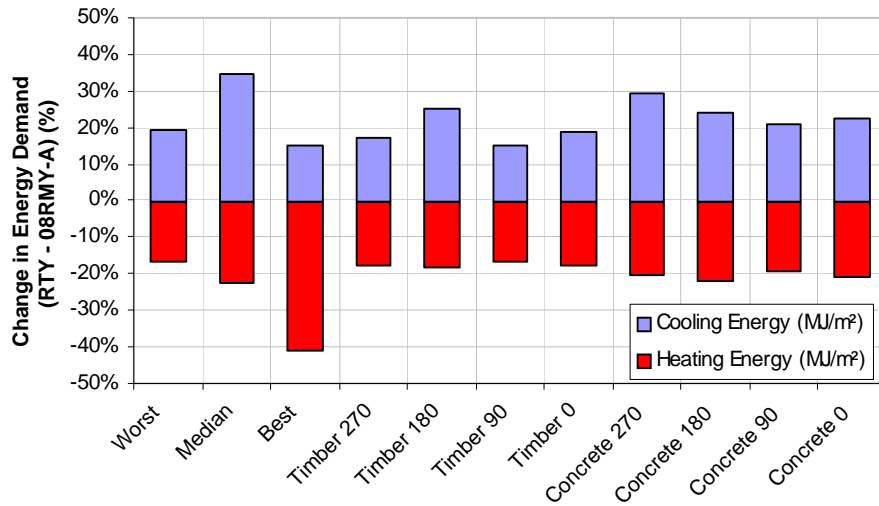

**Figure 3: Total heating and cooling energy between RTY and RMY-A as a percentage of RMY-A**


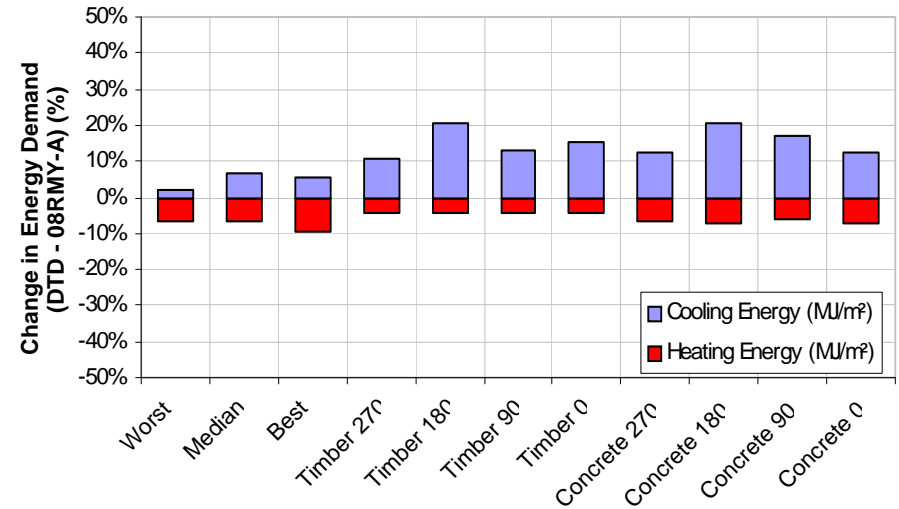


**Figure 4: Total heating and cooling energy between DTD and RMY-A as a percentage of RMY-A**

**Heating energy demand of both the RTY and DTD relative to RMY-A is smaller while cooling energy demand has increased**

**Indication of past climate change?**

# CREATION OF ERSATZ FUTURE WEATHER DATA FILES

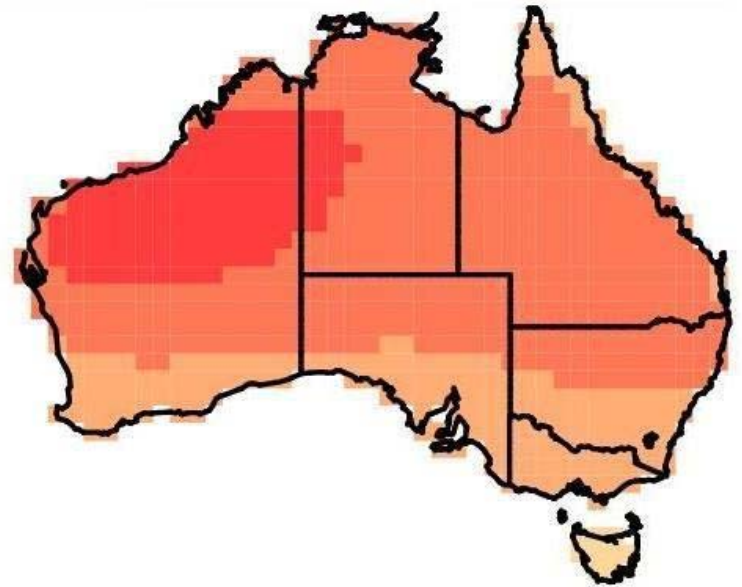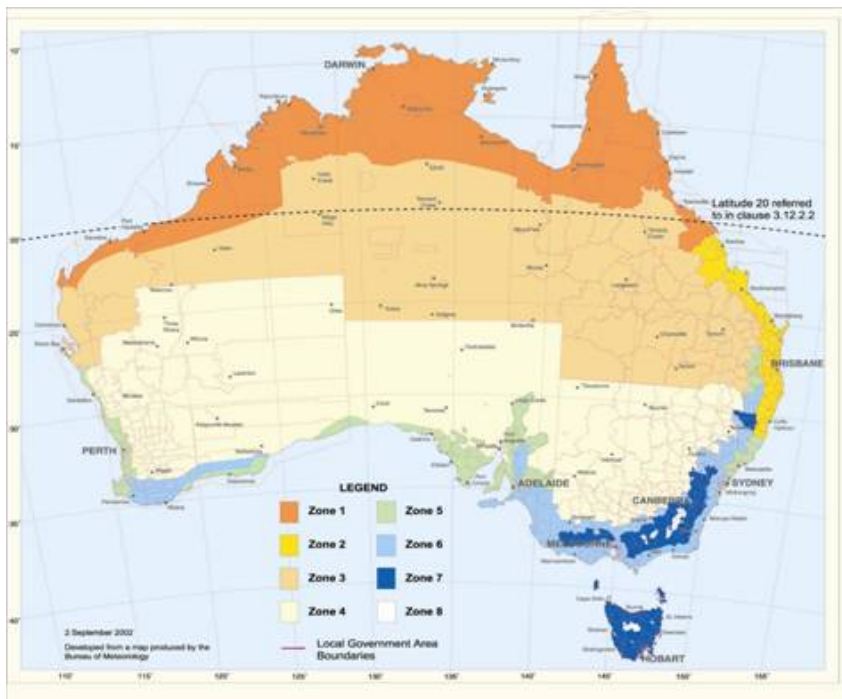

See separate paper on this specialised area in BS2011

# Conclusions

- Climate and weather data may be tailored to suit a wide range of renewable energy and energy conservation applications.
- ASRDH 4 and AUSOLRAD provide accurate irradiation data suitable for use in analysing building / thermal / PV energy performance. Soon to be supplemented and extended with Exemplary Australian Solar Energy Atlas.
- RMYs may be created to meet the specific requirements of an application based on the weighting assigned to the different weather elements.
- XMYs, YTDs and RTBPs can be created for system design and operational optimisation.
- Ersatz Future Weather Data based on “forecast” scenarios for climate change can project energy performance in the future.

# Climate Data for Building Optimisation and Energy Management

**Questions?**



**Trevor Lee**